


NOTES:

- 1. CONCRETE FOR PEDESTRIAN RAMP TO BE 125mm THICKNESS ON 75mm CLASS 3 FINE CRUSHED ROCK, WITH F72 REINFORCED MESH.
- 2. 10mm DEFORMED BARS TO BE DOWELLED A MIN 150mm INTO PEDESTRIAN CROSSING, AND 150mm INTO KERB AND CHANNEL AT 350mm CENTRES.
- 3. THE RAMP AND SLOPING SIDES SHOULD BE SLIP RESISTANT. USE BROOM SURFACE FINISH.
- 4. REFER TO A.S.1428.1 AND A.S.1428.4 FOR PROFILE AND CORRECT PLACEMENT OF TGSI'S.

 (IF CONFLICT OCCURS BETWEEN COUNCIL'S STANDARD DWG AND AUSTRALIAN STANDARDS, DEFER TO AUSTRALIAN STANDARD.)
- 5. TACTILES ARE TO BE OF AN APPROVED CERAMIC MATERIAL. (UNLESS OTHERWISE SPECIFIED BY CONTRACT SUPERVISOR)
- 6. TACTILE COLOR MUST BE IVORY, WITH A CERTIFICATE OF LUMINANCE COMPLIANCE (TO AS1428 IN WET AND DRY CONDITIONS) TO BE SUPPLIED BY THE MANUFACTURER (UNLESS OTHERWISE SPECIFIED BY THE CONTRACT SUPERVISOR).
- 7. MANUFACTURER MUST SUPPLY SPECIFICATION FOR INSTALLATION OF TACTILES. INSTALLATION MUST BE IN ACCORDANCE WITH THIS SPECIFICATION. (UNLESS OTHERWISE SPECIFIED BY THE CONTRACT SUPERVISOR).

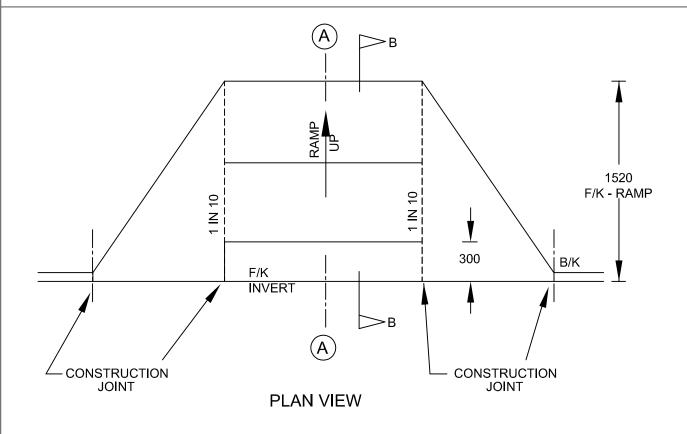

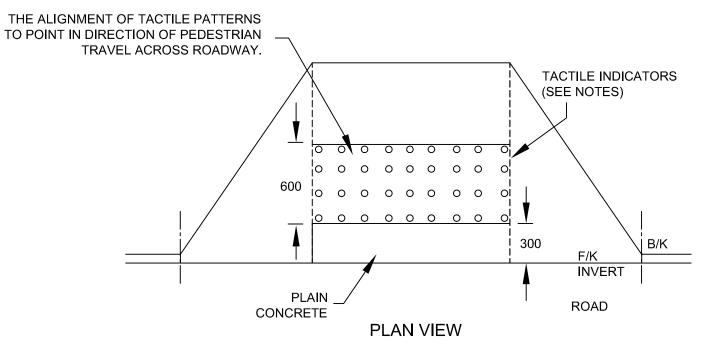

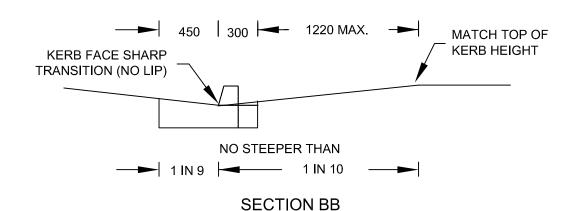


		T/KERE
1000	1500	—————————————————————————————————————

ELEVATION A

CITY OF BALLARAT

No.	AMENDMENTS	DA	ГЕ	Approved	by:
1	ADDED TACTILE INDICATORS	DEC	00		
2	CHANGED NOTES	APR	04		
3	CHANGED CONSTRUCTION JOINTS	NOV	11		
4	CONSTRUCTION NOTES ADDED	SEP	13		
				Date:	

PEDESTRIAN KERB
RAMP DETAIL
WITH TACTILE INDICATORS



SCALE: NOT TO SCALE

SHEET 1 OF 4

SD-C4-1

DRAWING NO: